



PUBLIC HEALTH DEPARTMENT

IMPROVEMENT PERMIT (IP)(Building permit cant be issued with only an IP ON-SITE WASTEWATER


Applicant/Owner	Todd Withrow	# of Bedrooms	3	# of Occupants	6
Directions	Tusquittee Rd to L on Qualla to R on Piney to Sweetwater Bend on R after 194	Pump Required	Yes		
Location	Just past 194 Sweetwater Bend				
Design Flow	360 gal/day	Facility Type	3 Bedroom House	Permit Type	New Construction
Foundation	Not Specified	Water Source	To Be Applied For	Expiration	10/3/2028

Permit Conditions

Do NOT install system until a construction authorization is obtained. After surveying is complete and recorded and construction authorization is obtained, meet the following conditions upon installation. Dig trenches level and on contour in location shown. Do NOT bench drain lines and do NOT remove large stumps from drain line area. Meet all setbacks shown. Plumb as shown.

Justin M. [Signature] Authorized State Agent Date: 10/3/2023

The issuance of this permit by CCHD in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This permit is subject to revocation if the site plan, plat, site or intended use changes. The improvement permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit. **Questions? (828) 389- 8326.**Diagram (Not to Scale)

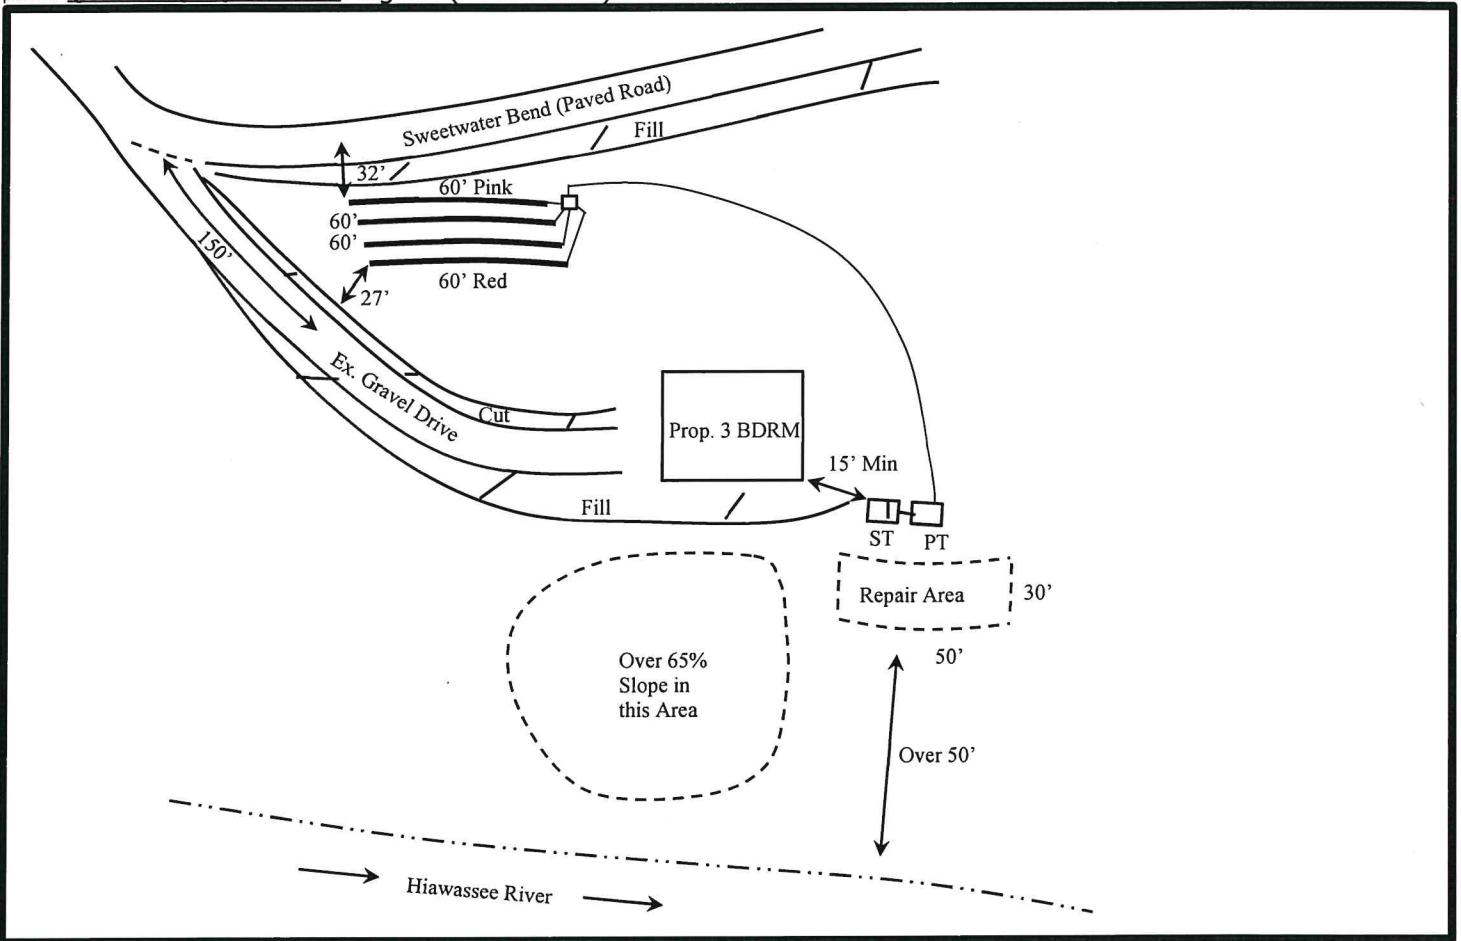

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by reference into this permit and shall be met. Systems shall be installed in accordance with the attached layout.

INITIAL	10" Large Diameter Pipe – Effluent Pump				REPAIR	Drip Dispersal		
Type IIIf	Soil Depth: 34-40 (In)	Slope: 35-43%	LTAR: 0.6	Saprolite: NO	Type Vc	Area 1500(ft ²)	LTAR: 0.3	Saprolite: No
CONSTRUCTION AUTHORIZATION (CA)	TOTAL LENGTH	# OF LINES	MIN DEPTH	MAX DEPTH	WIDTH	DISTRIBUTION	SEPTIC TANK	PUMP TANK
	240'	4	18 " Low side	18 " low side	12 inches	Serial - PVC	1000 gallon	1000 gallon
SOIL COVER MIN	SOIL COVER MAX	OSW CERT. GRADE	OTHER DOCS.	PUMP SPECS	MIN SPACING			
6"	12"	II	Choose	Click here	6 'on center			

Authorized State Agent Date: